
ONTARIO FIRE DEPARTMENT FIRE PROTECTION STANDARD



ON-SITE HYDRANTS

STANDARD #D-005

EFFECTIVE 11-08-05 PAGES 1

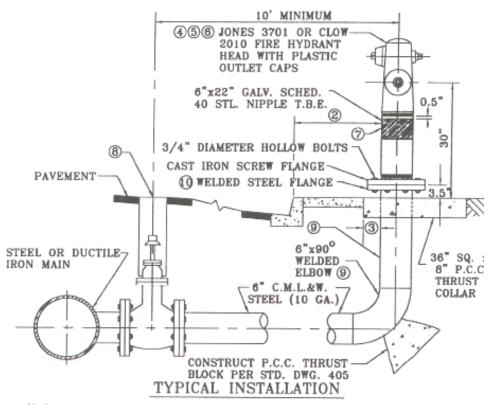

NOT TO SCALE

SIDEWALK

45°

NOTES

- 1. FIRE HYDRANT SHALL BE INSTALLED NOT CLOSER THAN FIVE FEET FROM A DRIVEWAY, STREET LIGHT, POWER
- 2. 20" BEHIND CURB FACE WHEN THE SIDEWALK IS ADJACENT TO THE RIGHT-OF-WAY.
- 3. 12" BACK OF WALK WHEN SIDEWALK IS ADJACENT TO CURB.
- PRIME COAT SHALL BE RUSTOLEUM NO. 960 RUST INHIBITIVE YELLOW PRIMER OR CITY ENGINEER APPROVED EQUAL
- INSTALL BLUE REFLECTIVE PAVEMENT MARKER PER STANDARD DRAWING NO. 4004
- FINISHED PAINT COAT SHALL BE OD QUAKER **ENVIROGLOSS YELLOW EXTERIOR ENAMEL (EN21712015),** OR CITY ENGINEER APPROVED EQUAL.
- 7. 4 INCH WIDE REFLEXITE AP-1000 PER OFD STD #D-002 APPLIED WITH 1.5 INCH OVERLAP OF SEAM.
- GATE VALVE PER STANDARD DRAWING NO. 4028.
- 9. 6" C.M.L.&W. SCHEDULE 40 STELL PIPE.
- 10. STANDARD 8 3/4" DIAMETER BOLT PATTERN WELDED STEEL FLANGE

Std. #D-005 Onsite Hydrant Standard Page 1 of 1 Rev. 12-07-05