


## ONTARIO FIRE DEPARTMENT FIRE PROTECTION STANDARD

## FIRE HYDRANT IDENTIFICATION

STANDARD #D-002

**EFFECTIVE 02-15-00** 

PAGES 1

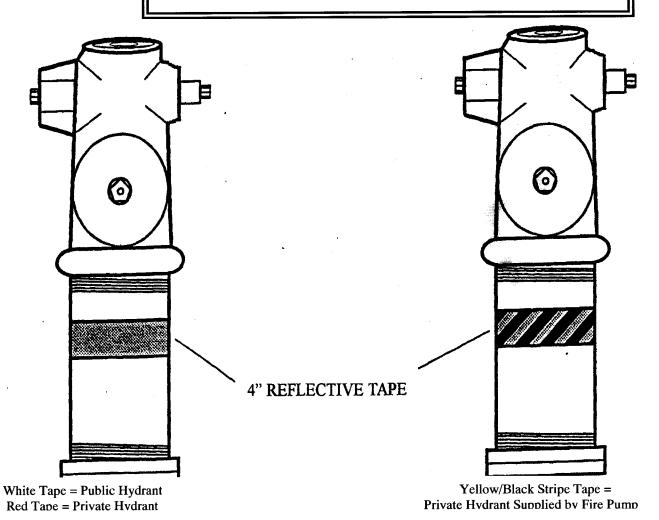

## **PURPOSE:**

This standard is provided to serve as a visual example of the proper identification measures for fire hydrants in the City of Ontario.

## **SPECIFICATIONS:**

- 1. Prime coat must be Rustoleum No. 960 Rust Inhibitive Yellow Primer or approved equal.
- 2. Finished paint coat shall be Old Quaker Envirogloss Yellow Exterior Enamel (EN 21712015) or approved equal.
- 3. Reflective tape shall be 4" wide self-adhesive tape applied with a 1.5" overlap of the seam. Red and white to be 3-M #PT-10; yellow/black to be Reflexite AP-1000 or approved equal.
- 4. Install blue reflective pavement marker per City of Ontario Standard Drawing No. 4302.
- 5. Do not paint brass hydrant threads.